

# FIRE ALARM EQUIPMENT

## FIRE ALARM SYSTEMS (CONVENTIONAL)

## FIRE ALARM PANELS

- Standard 4-48 zones in 4 zones increment
- Complies to BS 5839: pt 4: 1988
- Complies to SS : CP 10: 1993


- Gas detectors (propane LPG, butane, methane, isobutane, etc)
- Duct detectors
- UV flame detectors
- Optical smoke detectors (220 VAC)

## LOW PROFILE DETECTORS (LPC, UL, FM)

- Ion, optical detectors
- Heat detectors (ROR & FT), programmable heat detectors (60, 70, 80, 90°C)

## FIRE ALARM ACCESSORIES

- Manual call points (LED, Perspex or glass break)
- Xenon beacon, electronic sounder
- Alarm bells
- Remote LED indicators
- Magnetic door holders
- Detector tester
- Detector removal tools

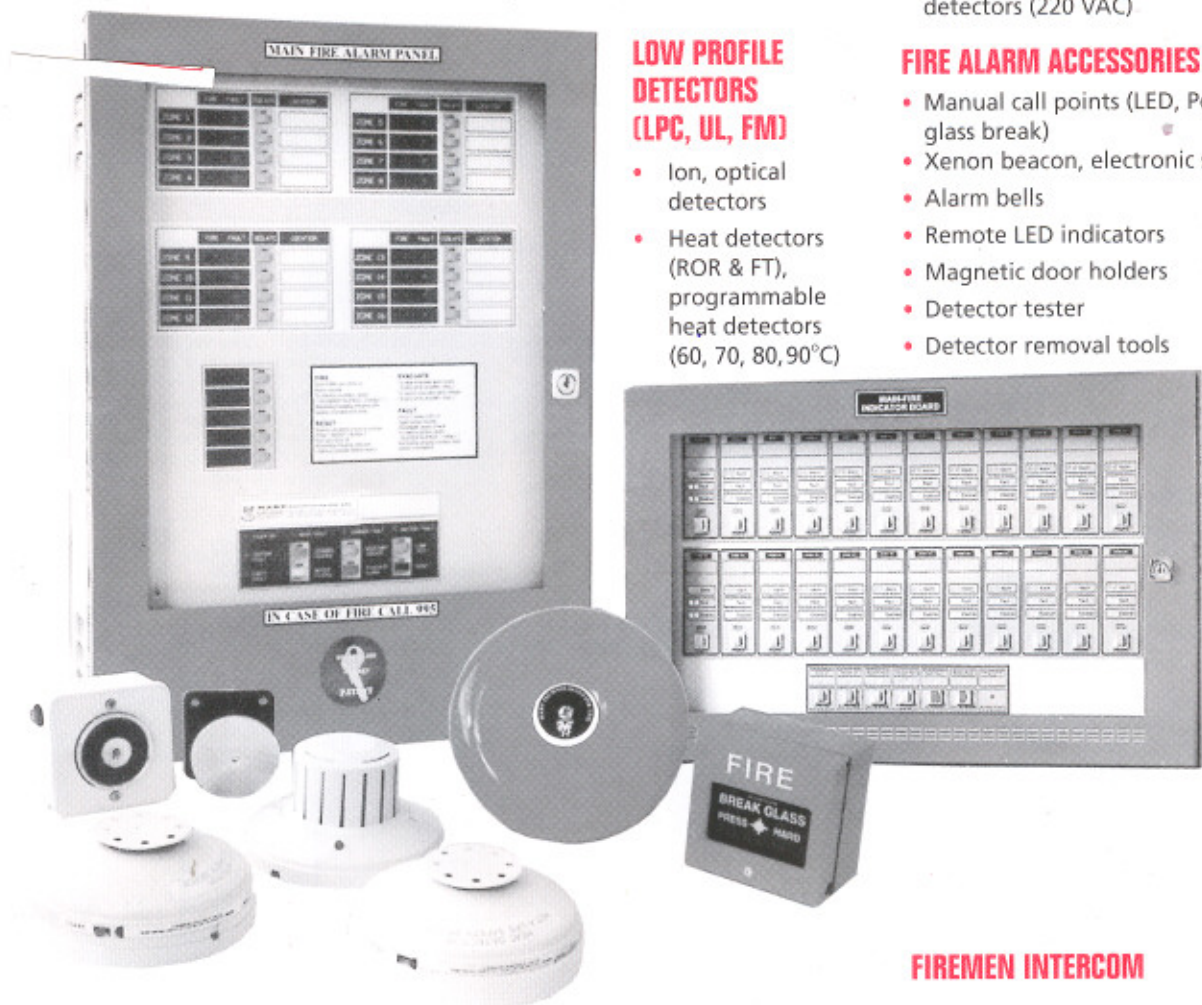

## FIREMEN INTERCOM